
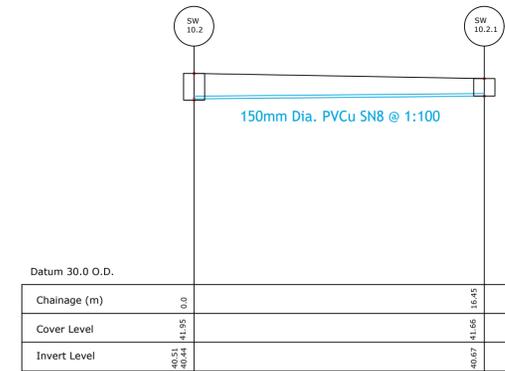
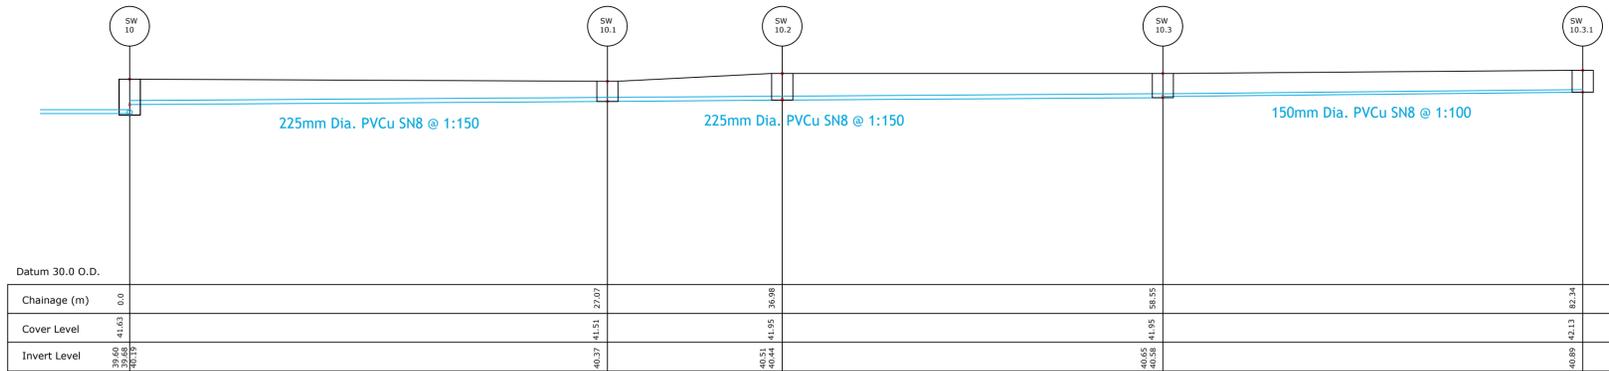
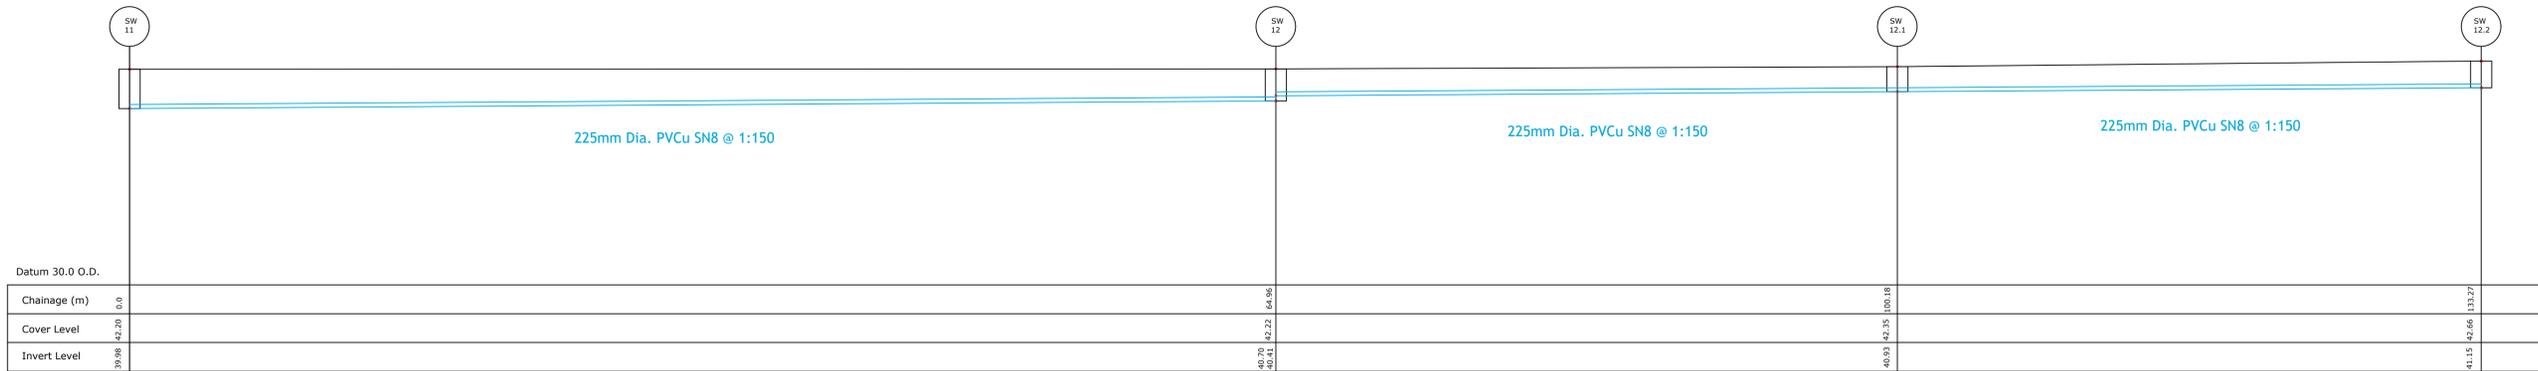
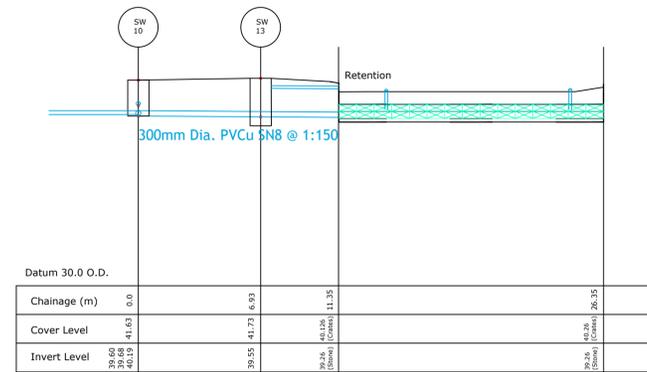


Surface Water Chambers									
Designation	Cover Level	Invert Level		Chamber Type	Cover Grade	Depth	Diameter	Trafficked	Y/N
		in	out						
SW10	41.63	39.68	39.6	MH	D400	2.03	225/300	Y	
SW10.1	41.51		40.37	MH	D400	1.14	225	Y	
SW10.2	41.95	40.51	40.44	MH	D400	1.51	225/150	Y	
SW10.2.1	41.66		40.67	MH	D400	0.99	150	Y	
SW10.3	41.95	40.65	40.58	MH	D400	1.37	225/150	Y	
SW10.3.1	42.13		40.89	MH	D400	1.24	150	Y	
SW11	42.2		39.98	MH	D400	2.22	225	Y	
SW12	42.22	40.7	40.41	MH	D400	1.81	225	Y	
SW12.1	42.35		40.93	MH	D400	1.42	225	Y	
SW12.2	42.66		41.15	MH	D400	1.51	225	Y	
SW13	41.73		39.36	MH	B125	2.37	300	N	
SW14	42.61		41.2	MH	D400	1.41	150	Y	
SW14.1	42.5		40.93	MH	D400	1.59	225/150	Y	
SW15	42.27		40.84	MH	D400	1.43	225	Y	
SW15.1	42.3		40.61	MH	D400	1.69	225	Y	
SW16	42.45		40.81	MH	B125	1.64	225	N	
SW17	42.55		41.63	IC	B125	0.92	225	N	
SW18	42.43		40.9	MH	B125	1.53	225	N	
SW19	42.1		40.87	MH	B125	1.23	225	N	
SW20	42.3		41.4	MH	B125	0.9	225	N	
SW21	42.2		41.28	MH	B125	0.92	225	N	
SW22	42		41.08	MH	B125	0.92	225	N	
SW23	42.3		40.62	MH	B125	1.68	225	N	
SW23.1	41.78		40.34	MH	B125	1.44	225	N	
SW24	42.05		40.93	MH	B125	1.12	225	N	

All levels and inverts to be checked by on-site engineer. Inverts & cover levels may be subject to change, depending on final configuration. Any discrepancies to be reported to Engineer.

PC Concrete MH 1500B
PVCu IC 600B
IC's in excess of 1.2m to have restricted access cover of 350B
All PPVC chambers covers to be bolt down

All chamber covers to be EN124:
Trafficked Areas - D400
Non-trafficked areas - C250
Pedestrian - B125

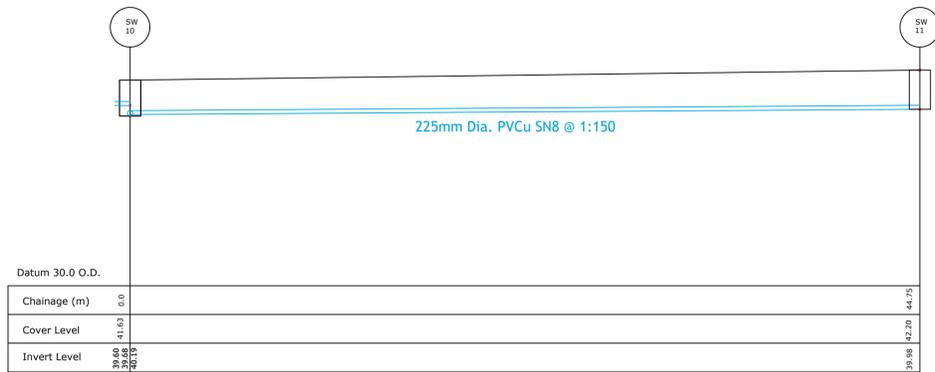

Pipe Specifications:
Surfacewater Pipes: Unplasticised PVC; Unplasticised PVC pipes and fittings shall comply with the provisions IS EN 1401 2009/2012. Pipes to be application area code "UD", Stiffness Class 8kN/m2. Provision for jetting shall be based on the WRC Sewer Jetting Code of Practice, June 1997. Pipes to be capable of resisting a maximum jetting pump pressure of 2,600psi (180 Bar) without damage. (Sewer diameters 150mm up to 450mm, Service Connections of 100mm diameter.)

Surfacewater: Gravity Sewers and Rising Mains shall be designed in accordance with the requirements of BS 9295. As a general guide the, minimum depth of cover from the finished surface to the crown of pipework without protection should be as follows:
 • Areas without any possibility of vehicular access - depth not less than 0.5 m;
 • Driveways, parking areas and yards with height restrictions to prevent entry by vehicles with a gross vehicle weight in excess of 7.5 tonnes - depth not less than 0.75 m;
 • Driveways, parking areas and narrow streets without footways (e.g. mews developments) with access for vehicles with a gross vehicle weight in excess of 7.5 tonnes - depth not less than 0.9 m;
 • Agricultural land and public open space - depth not less than 0.9 m;
 • Other roadways, highways and parking areas with unrestricted access to vehicles with a gross vehicle weight in excess of 7.5 tonnes - depth not less than 1.2 m.

The depth of cover to pipework can be reduced by the installation of concrete beds and surrounds.

Refer to revision sheet for all amendment details			
Client: Wrightwood Developments Ltd.			
Project Title: New Development at, Ardshanavooley, Killarney			
Drwg Title: Surface Water Sections			
Drwn by: JON		Date: Sept 2025	
chckd by: M.C		Date: Sept 2025	
Job No: 91-24		Scale: 1:200	
Drwg No: 91-24-1-810		Ref: Sheet Rev A	
Issue for: Planning			

